




# Overhead Temporary Service Wiring Diagram

**\*\*\* Call 811 Before You DIG!! \*\*\***

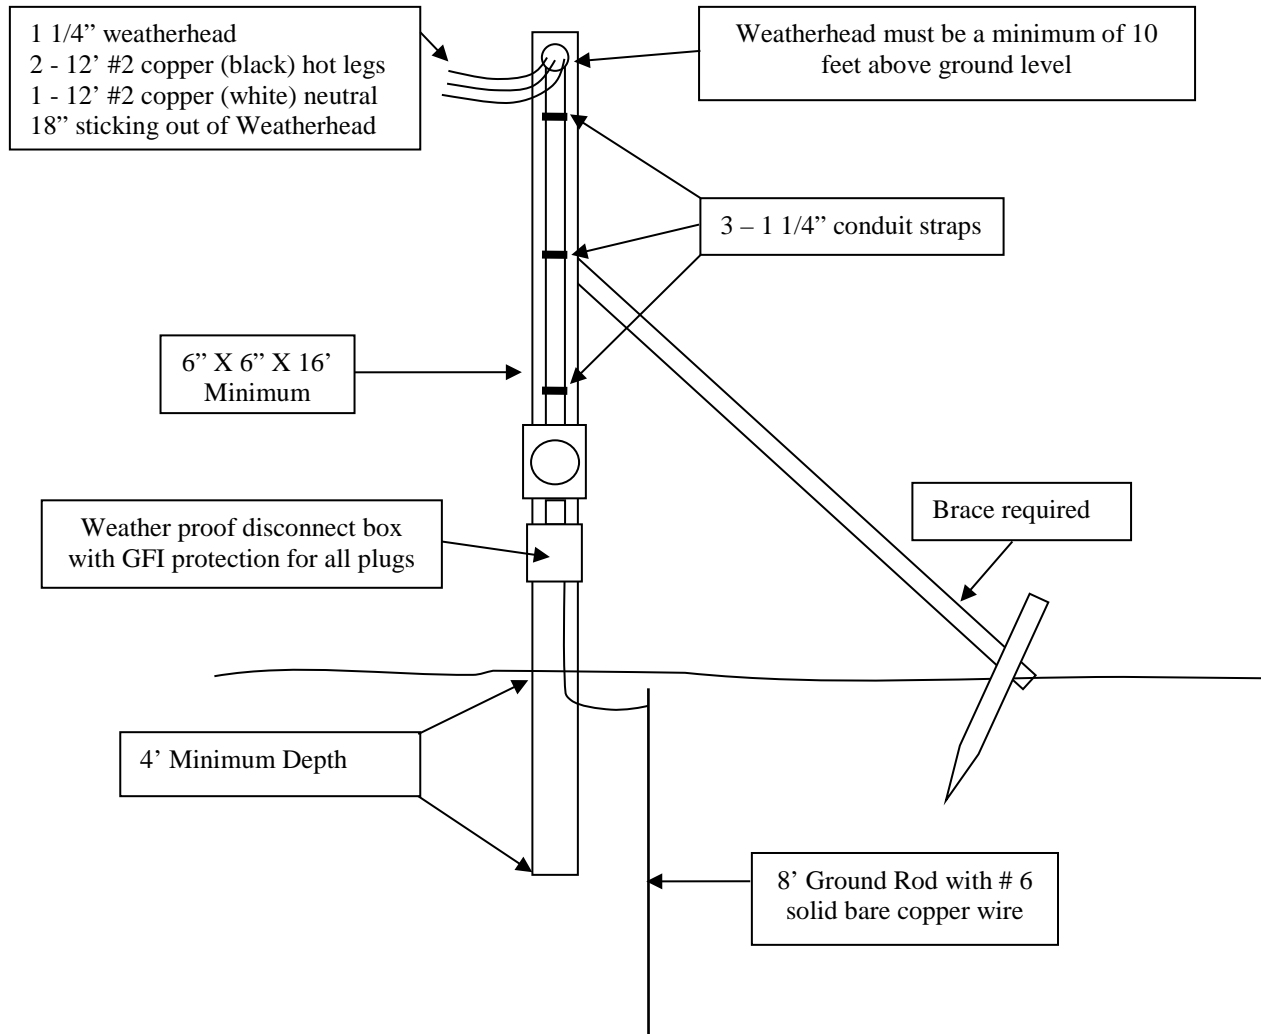

Mount meter base and 60 amp or larger service wiring on 6" X 6" post that is securely braced. Post must be a minimum of 12 feet above ground with weather head mounted a minimum of 10 feet above ground and securely fastened to the post with at least 3 straps. Temporary service must be installed no closer than 15 feet and no further than 50 feet from available over-head power source. Service wire cannot go over areas readily accessible to traffic. Install weatherproof disconnect box with GFI protection and ground to an 8 foot ground rod driven at least 18" from post. Any temporary service deemed unsafe by any Northeast MS EPA employee will be disconnected without notice and will be re-connected when it is made safe.

**Please call North East Mississippi Electric Power Association if you have any questions!!!**

**Installations NOT MEETING THE ABOVE GUIDELINES WILL BE REJECTED  
and are subject to a Special Trip Charge!!!**